




LESLIE-AIRMATE PNEUMATIC RELAYS

Volume Boosting

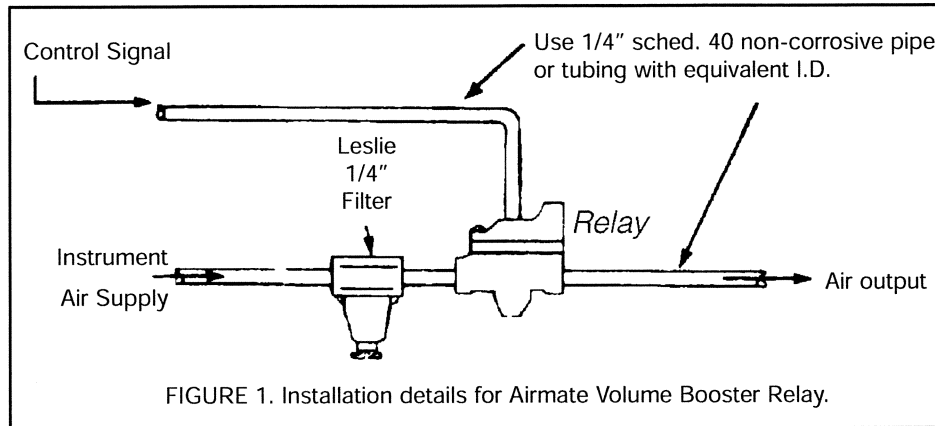

SECTION I—INSTALLATION

Install as shown in figure 1. Use non-corrosive piping or tubing and fittings throughout. Use Leslie 1/4" filter or strainer with poromet filter.



1:1B VOLUME BOOSTER RELAYS (figure 2). Adjust needle valve (36) to produce bleed action desired. Turn needle valve clockwise to decrease bleed; counterclockwise to increase bleed.

SECTION II—OPERATION

1. Turn on air supply and control signal to the relay.
2. Adjust relay, when necessary, as follows:

SECTION III—MAINTENANCE

NOTE: MAIN BODY ASSEMBLIES WITH COMPONENT PARTS ARE SIMILAR IN ALL RELAYS MENTIONED IN THIS INSTRUCTION.

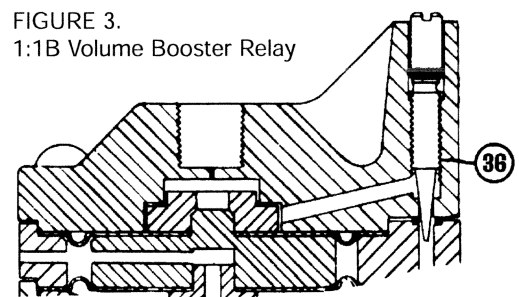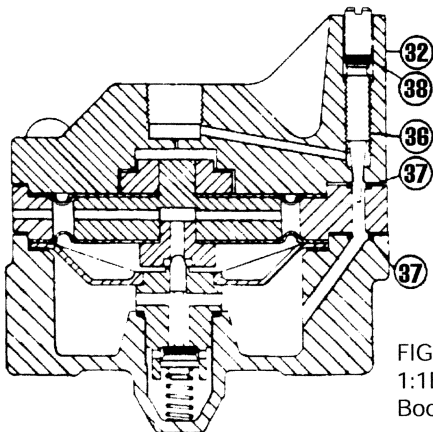

Dismantling

1. Shut off air supply and control signal. Disconnect control signal line at cover (32).
2. Remove screws. Lift off cover (32), diaphragm assembly (parts 10, 11, 13, and 34) and vent chamber (35).
3. Grip internal rib of aspirator plate (14) with narrow nosed pliers at point marked "Lift Here" and lift aspirator plate out of main body (15). Remove gasket (12). Unscrew valve seat (16) with "O" ring (17) from main body. Lift out main valve (18) with "O" ring (19) and main valve spring (20).

Cleaning or Replacing Parts

Clean all parts with a detergent non-injurious to synthetic materials. Wipe dry with clean cloth. Make sure port areas are free and clear. Replace any worn or damaged parts.

Reassembling

1. Place main valve spring (20) in main body. Place "O" ring (17) on valve seat (16). Assemble main valve (18) with "O" ring (19) in valve seat (16). Screw valve seat with parts into main body and tighten.
2. Place gasket (12) in recess of main body. Insert aspirator plate (14) with aspirator tube in outlet side. Snap aspirator plate in place (16) with finger pressure. Place nozzle/diaphragm assembly in main body with disc (10) upward. Position diaphragm assembly, (parts 10,11,13 and 34) on main body.


In diaphragm assembly (parts 10, 11, 13 and 34) diaphragms are pre-assembled to diaphragm spacer (34). When assembling vent chamber (35) to main body bend upper diaphragm carefully upward around diaphragm disc (10) so that vent chamber will clear upper diaphragm as it is placed on main body. Then allow diaphragm to fall into its position.

3. Assemble cover (32) to vent chamber. Tighten firmly
4. Reconnect Pneumatic lines and place into operation.

MAINTENANCE OF FILTER ASSEMBLY

To clean or replace filter (23). Disassemble filter Case (26) and gasket (12) from cover (32). Separate filter (23) and filter support disc (25) from filter case. Clean all parts thoroughly. Replace filter if necessary.

To reassemble. Place filter support disc (25) and filter (23) in filter case (26). Assemble gasket (12) and filter case (26) to cover (32). Insert screws and tighten.

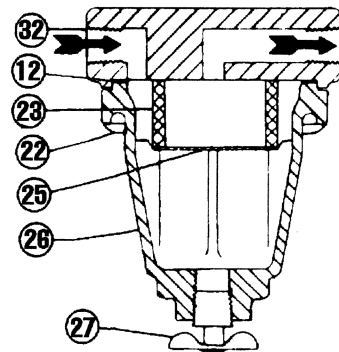

RELAY 1:1 VOLUME BOOSTING

PART NO.	PART NAME	MATERIAL	QTY. PER UNIT	REF. NO.
7	Screw, Phillips Hd.	Steel, Cad. Plated	4	53674
10	Diaphragm Disc**	Celcon	1	55244
11	Diaphragm**	Synthetic Rubber	2	58066
12	Gasket	Synthetic Rubber	1	52992
13	Nozzle**	Delrin* (Acetal Resin)	1	54726
14	Pilot Plate	Celcon	1	52899
15	Main Body	Aluminum	1	52664
16	Valve Seat	Aluminum	1	52676
17	O-Ring	Synthetic Rubber	1	51162
18	Main Valve, Comp.	Celcon	1	54488
19	O-Ring	Polyurethane 1	54458	
20	Main Valve Spring	Music Wire, Cad. Plated	1	55248
32	Cover	Cast Aluminum	1	54719
34	Diaphragm Spacer**	Aluminum	1	54707
35	Vent Chamber	Cast Aluminum	1	54703

* E. I. du Pont de Numours & Co., Inc.

** Note: Part No.'s 10, 11, 13 & 34 furnished only as Diaphragm Nozzle Disc Complete. Ref. No. 60668.

PATENTED

☛ = Recommended Spare Parts




★ = These parts should be on hand, plus recommended spare parts, when overhauling this equipment.

INPUT SIGNAL AND OUTPUT PRESS.

Ranges 1-150 PSI

Max. Temp. 150° F

Supply Press. Range 15 PSI above highest output, 200 PSI max.

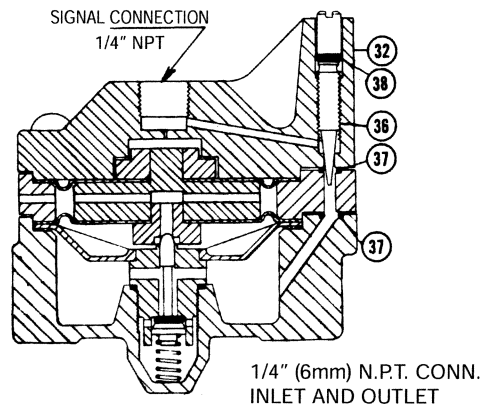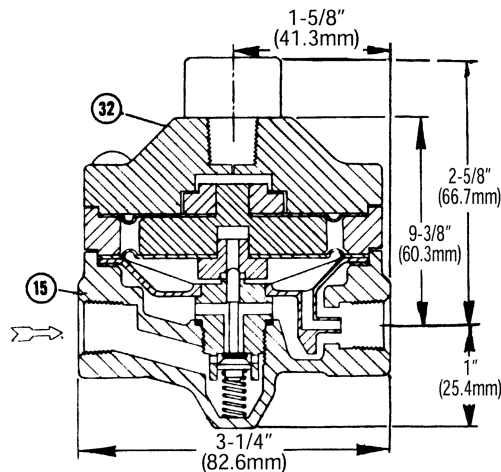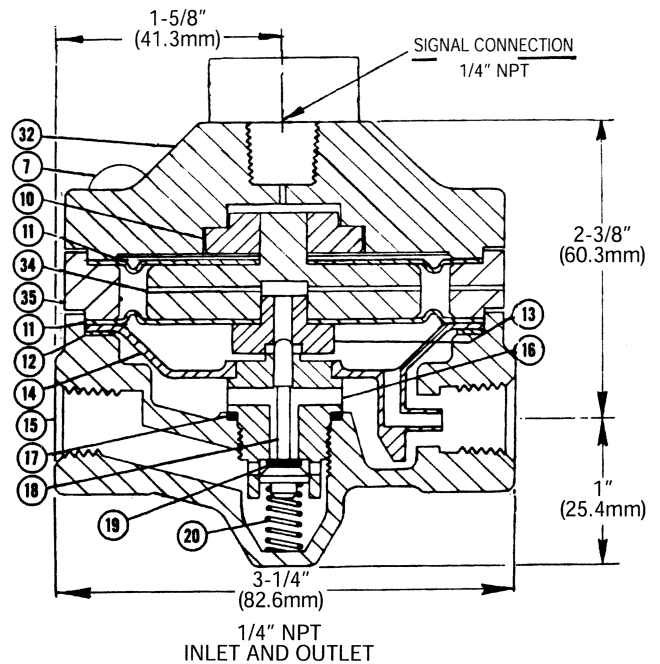

PART NO.	PART NAME	MATERIAL	QTY. PER UNIT	REF. NO.
15	Main Body	Aluminum	1	54731
32	Cover	Cast Aluminum	1	54720
36	Needle Valve	Stainless Steel	1	54728
37	O-Ring	Synthetic Rubber	2	54737
38	O-Ring	Synthetic Rubber	1	23869

INPUT SIGNAL AND OUTPUT PRESSURE RANGER 1 - 150 PSI
MAX. TEMP. 150° F.


All parts not shown same as 1:1 Relay

RELAY 1:1B VOLUME BOOSTING

MOUNTING BRACKET

(for all relays)
Furnished on request only
Ref. No. 56222
Mat'l - Steel

SUPERSEDES DWG. NO. CP-20325F

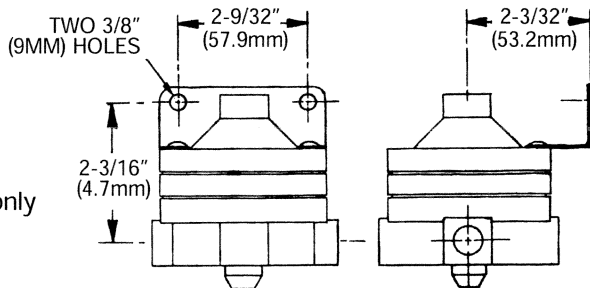

LESLIE CONTROLS, INC. TAMPA, FL 33637			
LESLIE- AIRMATE RELAYS AND FILTER			
DATE	APP'D.	D'W'N	DWG. NO.
6-11-81	JR	BW	20/6.4.1 ALT. 10
PRINTED IN USA 790W 5C			


RELAY 1:3 (DIVIDING)

☛ RECOMMENDED SPARE PARTS

RELAY 1:3 (MULTIPLYING)

PART NO.	PART NAME	MATERIAL	QTY. PER UNIT	REF. NO.
34	Diaphragm Spacer	Aluminum	1	54708
35	Vent Chamber	Cast Aluminum	1	54705
☛41	Diaphragm, Upper	Synthetic Rubber	2	58067
☛42	Diaphragm, Lower	Synthetic Rubber	1	58066


1/4" (6mm) N.P.T. CONN. INLET AND OUTLET

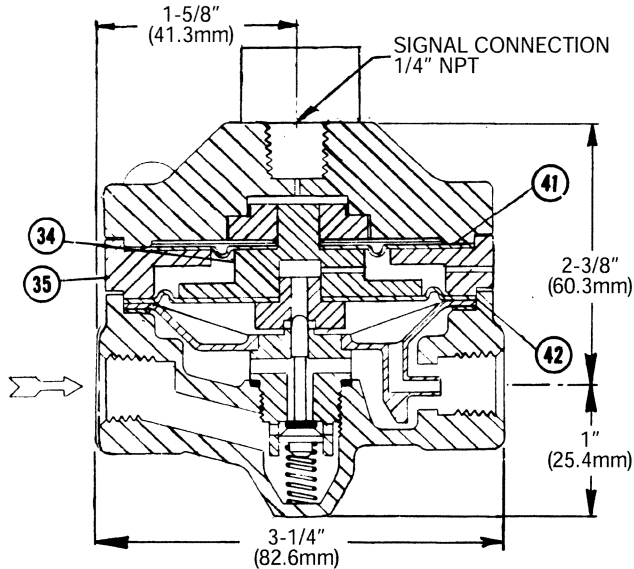

INPUT SIGNAL PRESSURE RANGE = 1- 150 PSI
 OUTPUT PRESSURE RANGE = 1- 50 PSI
 MAXIMUM TEMPERATURE = 150° F

PART NO.	PART NAME	MATERIAL	QTY. PER UNIT	REF. NO.
34	Diaphragm Spacer	Aluminum	1	55245
35	Vent Chamber	Cast Aluminum	1	54706
☛41	Diaphragm, Upper	Synthetic Rubber	2	58066
☛42	Diaphragm, Lower	Synthetic Rubber	1	58067

1/4" (6mm) N.P.T. CONN. INLET AND OUTLET

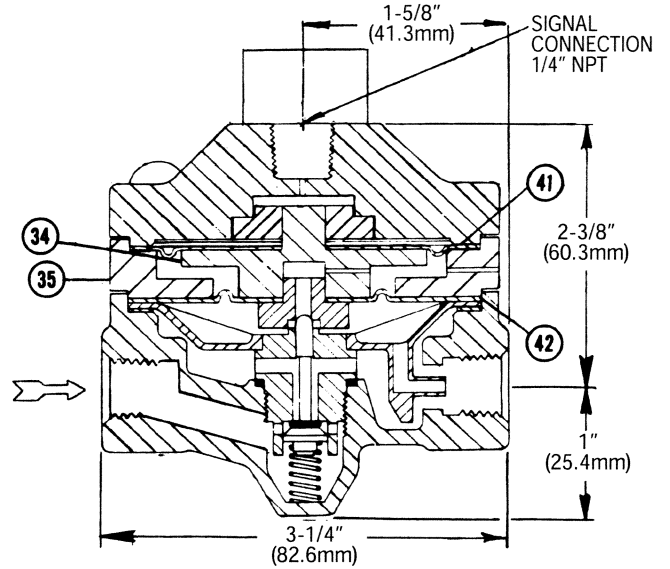


INPUT SIGNAL PRESSURE RANGE = 1- 50 PSI
 OUTPUT PRESSURE RANGE = 1- 150 PSI
 MAXIMUM TEMPERATURE = 150° F

RELAY 1:1D BIASING

PART NO.	PART NAME	MATERIAL	QTY. PER UNIT	REF. NO.
2	Nut	Steel, Cad. Plated	1	24772
4	Top Spring Seat	Brass	1	20571
6	Adj. Spring	Spring Steel, Cad. Pl.	1	33974
7	Diaphragm Disc	Celcon	1	11689
8	Spring Case Assy.	Aluminum	1	54960
39	Lock Nut	Steel	1	11689
40	Adj. Screw	Stainless Steel	1	54740
43	Sealing Washer	Steel Cad. Plated	1	58358

INPUT SIGNAL AND OUTPUT PRESS.
 RANGE 1-150 PSI MAX. TEMP. 150° F

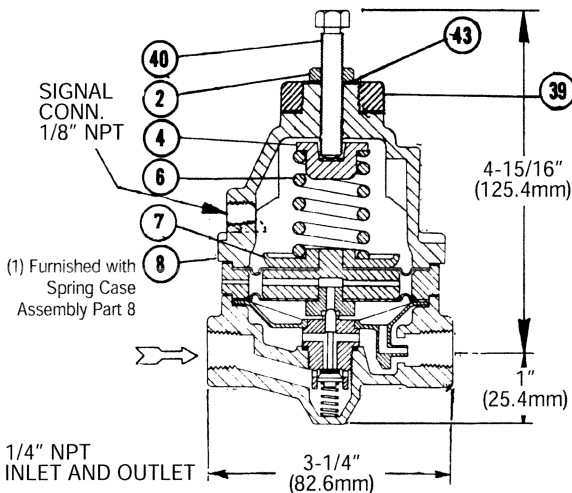


1/4" NPT
 INLET AND OUTLET

FILTER

PART NO.	PART NAME	MATERIAL	QTY. PER UNIT	REF. NO.
☛12	Gasket	Synthetic Rubber	1	52992
22	Screw, Phillips Hd.	Steel, Cad. Plated	1	52993
☛23	Filter, 5-10 Micron	NOTE 1	1	52936
25	Filter Support Disc	Stainless Steel	1	52990
26	Filter Case	Aluminum	1	52991
27	Drain Cock	Brass	1	58269
32	Cover	Cast Aluminum	1	54751

NOTE 1 - Resin Impregnated Cellulose

MAX. INLET PRESSURE - 200 PSI / MAX. TEMPERATURE - 150° F

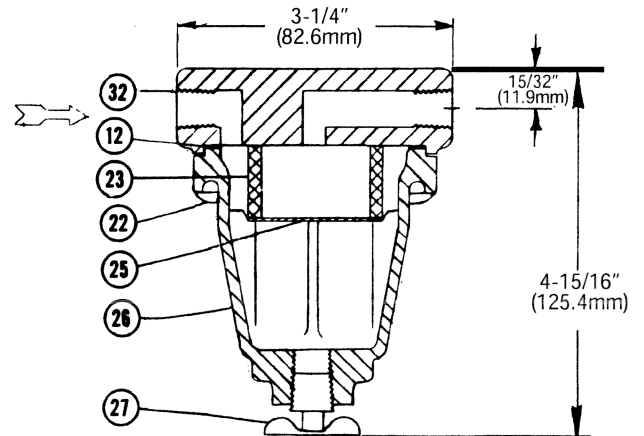

RECOMMENDED SPARE PARTS KIT - REF. NO. 001 9113 02

QTY. 10 - PART 12, REF. NO. 52992
 QTY. 10 - PART 23, REF. NO. 52936

20/6.4.1
 ALT.10